


Vertical Loads on Structures

Load Types

- Dead
- Live
- Snow

Load Combinations

- ASD
- LRFD

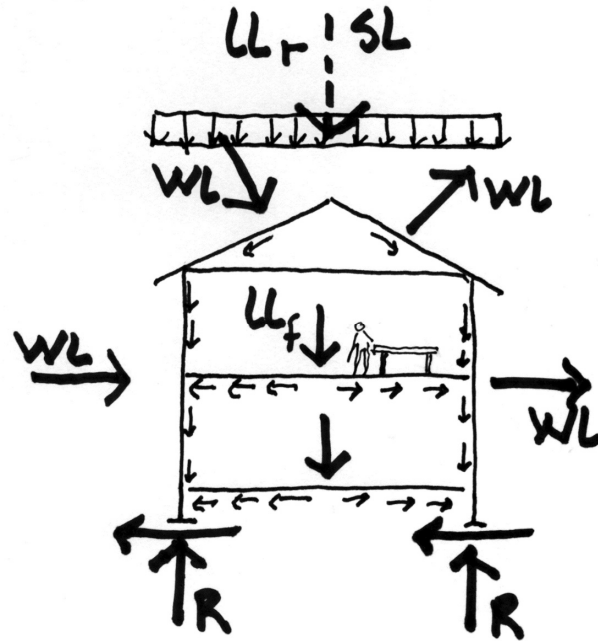

ASCE - 7

ASCE/SEI 7 Minimum Design Loads For Buildings and Other Structures

gives “minimum” loads for:

<https://ascehazardtool.org/>

Ch. 3 - Dead Loads

Ch. 4 - Live Loads

Ch. 5 - Flood Loads

Ch. 6 - Tsunami Loads


Ch. 7 - Snow Loads

Ch. 8 - Rain Loads

Ch. 10 - Ice Loads

Ch. 11-23 Seismic Loads

Ch. 26-31 Wind Loads

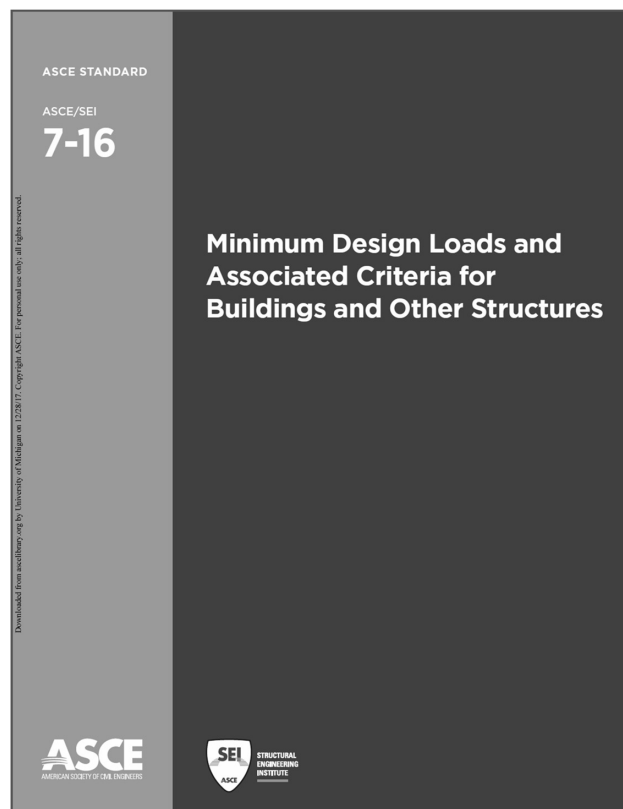

ASCE – 7 Ch. 2 - Load Combinations

Load Types

- Dead Load - D
- Roof Live Load - L_r
- Floor Live Load - L
- Snow Load - S
- Wind Load - W
- Earthquake - E

Allowable Stress Design (ASD)


Not factored

- D
- D + L
- D + (L_r or S)
- D + 0.75 L + 0.75 (L_r or S)
- D + (0.6W)
- D + 0.75L + 0.75(0.6W) + 0.75(L_r or S)
- D + 0.7E_v + 0.7E_h

Strength Design (LRFD)

With gamma (γ) safety factors 2022

- 1.4 D
- 1.2 D + 1.6 L + (0.5L_r or 0.3S or 0.5R)
- 1.2 D + (1.6L_r or S or 1.6R) + (L or 0.5W)
- 1.2 D + 1.0W + L + (0.5L_r or 0.3S or 0.5R)
- 0.9D + 1.0W
- 1.2D + E_v + E_h + L + 1.5S
- 0.9D - E_v + E_h

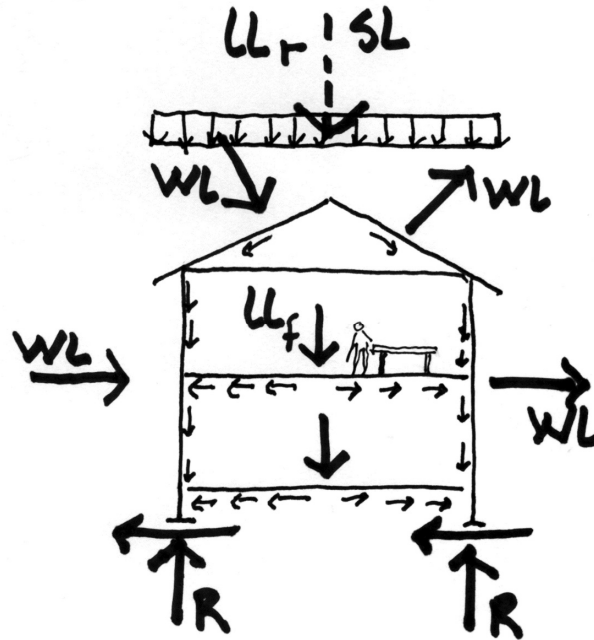

ASCE – 7 Chapter 3 Dead Loads

Ch. 3 - Dead Loads

Ch. 4 - Live Loads

Ch. 5 - Flood Loads

Ch. 6 - Tsunami Loads

Ch. 7 - Snow Loads

Ch. 8 - Rain Loads

Ch. 10 - Ice Loads

Ch. 11-23 Seismic Loads

Ch. 26-31 Wind Loads

CHAPTER 3 DEAD LOADS, SOIL LOADS, AND HYDROSTATIC PRESSURE

3.1 DEAD LOADS

3.1.1 Definition. Dead loads consist of the weight of all materials of construction incorporated into the building including, but not limited to, walls, floors, roofs, ceilings, stairways, built-in partitions, finishes, cladding, and other similarly incorporated architectural and structural items and fixed service equipment, including the weight of cranes and material handling systems.

3.1.2 Weights of Materials and Constructions. In determining dead loads for purposes of design, the actual weights of materials and constructions shall be used, provided that in the absence of definite information, values approved by the Authority Having Jurisdiction shall be used.

3.1.3 Weight of Fixed Service Equipment. In determining dead loads for purposes of design, the weight of fixed service equipment, including the maximum weight of the contents of fixed service equipment, shall be included. The components of fixed service equipment that are variable, such as liquid contents and movable trays, shall not be used to counteract forces causing

overturning, sliding, and uplift conditions in accordance with Section 1.3.6.

EXCEPTIONS:

1. Where force effects are the result of the presence of the variable components, the components are permitted to be used to counter those load effects. In such cases, the structure shall be designed for force effects with the variable components present and with them absent.
2. For the calculation of seismic force effects, the components of fixed service equipment that are variable, such as liquid contents and movable trays, need not exceed those expected during normal operation.

3.1.4 Vegetative and Landscaped Roofs. The weight of all landscaping and landscaping materials shall be considered as dead load. The weight shall be computed considering both fully saturated soil and drainage layer materials and fully dry soil and drainage layer materials to determine the most severe load effects on the structure.

Table 3.2-1 Design Lateral Soil Load

Description of Backfill Material	Unified Soil Classification	Design Lateral Soil Load ^a psf per foot of depth (kN/m ² per meter of depth)
Well-graded, clean gravels, gravel-sand mixes	GW	35 (5.50) ^b
Poorly graded, clean gravels, gravel-sand mixes	GP	35 (5.50) ^b
Silty gravels, poorly graded gravel-sand mixes	GM	35 (5.50) ^b
Clayey gravels, poorly graded gravel-and-clay mixes	GC	45 (7.07) ^b
Well-graded, clean sands; gravel-sand mixes	SW	35 (5.50) ^b
Poorly graded, clean sands, sand-gravel mixes	SP	35 (5.50) ^b
Silty sands, poorly graded sand-silt mixes	SM	45 (7.07) ^b
Sand-silt clay mix with plastic fines	SM-SC	85 (13.35) ^c
Clayey sands, poorly graded sand-clay mixes	SC	85 (13.35) ^c
Inorganic silts and clayey silts	ML	85 (13.35) ^c
Mixture of inorganic silt and clay	ML-CL	85 (13.35) ^c
Inorganic clays of low to medium plasticity	CL	100 (15.71) ^d
Organic silts and silt-clays, low plasticity	OL	^e
Inorganic clayey silt, elastic silts	MH	^e
Inorganic clays of high plasticity	CH	^e
Organic clays and silty clays	OH	^e

^aDesign lateral soil loads are given for moist conditions for the specified soils at their optimum densities. Actual field conditions shall govern. Submerged or saturated soil pressures shall include the weight of the buoyant soil plus the hydrostatic loads.

^bFor relatively rigid walls, as when braced by floors, the design lateral soil load shall be increased for sand and gravel type soils to 60 psf (9.43 kN/m²) per foot (meter) of depth. Basement walls extending not more than 8 ft (2.44 m) below grade and supporting light floor systems are not considered as being relatively rigid walls.

^cFor relatively rigid walls, as when braced by floors, the design lateral soil load shall be increased for silt and clay type soils to 100 psf (15.71 kN/m²) per foot (meter) of depth. Basement walls extending not more than 8 ft (2.44 m) below grade and supporting light floor systems are not considered as being relatively rigid walls.

^dUnsuitable as backfill material.

Dead Load

The weight of material

by density:

MATERIAL	WEIGHT	CATEGORY
Aluminum	170 PCF	Metals/Alloys
Copper (cast)	556 PCF	Metals/Alloys
Iron (wrought)	485 PCF	Metals/Alloys
Lead	710 PCF	Metals/Alloys
Glass (plate)	161 PCF	Mineral
Sand	96 PCF	Mineral
Concrete (reinf.)	150 PCF	Mineral
Brick (common)	120 PCF	Mineral
Douglas Spruce Fir	32 PCF	Timber
White Oak	46 PCF	Timber
White Pine	26 PCF	Timber
Oil	57 PCF	Liquid
Water (39.2° F)	62.428 PCF	Liquid
Snow (fresh fallen)	8 PCF	Powder
Air	0.807	Gas

by area:


MATERIAL	WEIGHT	CATEGORY
Lightweight Concrete	6 - 10 PSF	Floors
1/4" Linoleum Finish	1 PSF	Floors
7/8" Hardwood Finish	4 PSF	Floors
Copper or Tin	1 PSF	Roofing
5-Ply felt and Gravel	6 PSF	Roofing
Asphalt Shingles	3 PSF	Roofing
Clay Tile Shingles	9 - 14 PSF	Roofing
3/4" Plywood Sheathing	3 PSF	Roofing
Wood studs 2 x 4	2 PSF	Partitions
1" Gypsum	5 PSF	Partitions
4" Brick	40 PSF	Walls
6" Hollow Conc. Block	43 PSF	Walls
8" Hollow Conc. Block	55 PSF	Walls
4" Glass Block	18 PSF	Walls
Windows, Glass	8 PSF	Walls

Dead Load



Weight of material

- weight of structure
- weight of permanent fixtures

Because it is known more precisely the LRFD safety factor is less: $\gamma = 1.2$

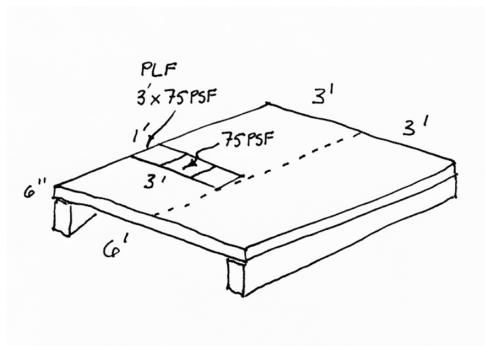

(concrete)

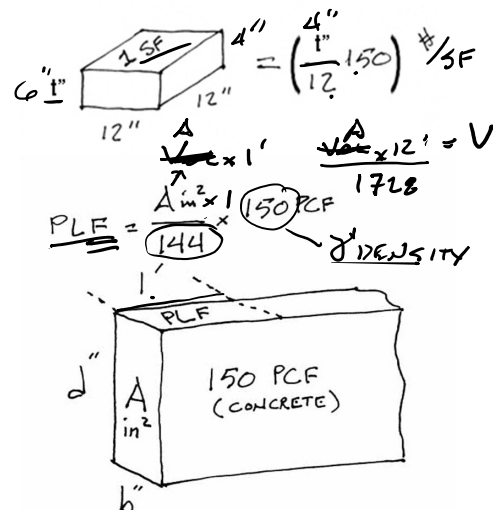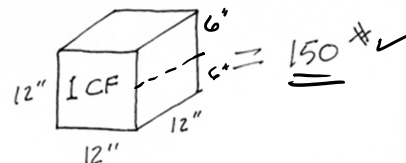

Dead Load

Floor framing

- Joist selfweight



$$PLF = \frac{\text{AREA (IN}^2\text{)} \times 1' \times \text{DENSITY (PCF)}}{144 \text{ in}^2}$$

- Joist weight on floor
on center space in inches (o.c.)

$$PSF = \frac{12}{24 \text{ O.C. (IN)}} \times PLF$$

Wood density by species: -
ca. 25 – 50 PCF

$$\begin{aligned} PLF &= \text{LBS/FT} \\ PSF &= \text{LBS/FT}^2 \\ PCF &= \text{LBS/FT}^3 \end{aligned}$$

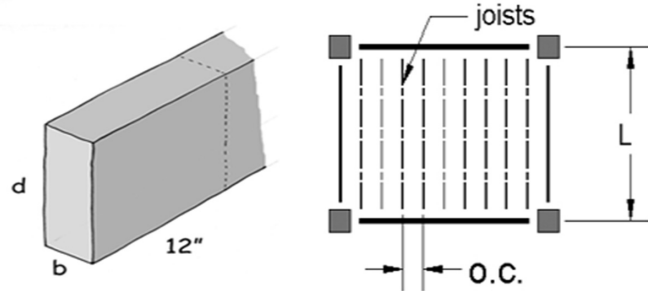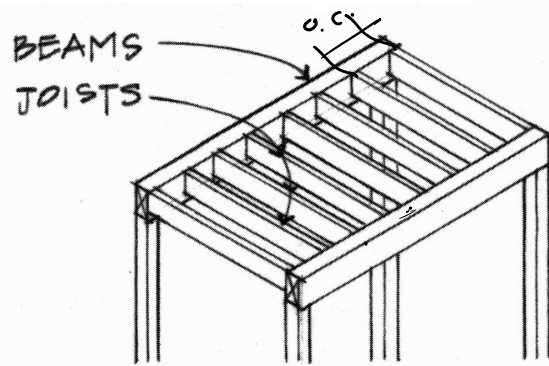

ASCE – 7 Chapter 4 Live Loads

Ch. 3 - Dead Loads

Ch. 4 - Live Loads

Ch. 5 - Flood Loads

Ch. 6 - Tsunami Loads

Ch. 7 - Snow Loads

Ch. 8 - Rain Loads

Ch. 10 - Ice Loads

Ch. 11-23 Seismic Loads

Ch. 26-31 Wind Loads

CHAPTER 4 LIVE LOADS

4.1 DEFINITIONS

The following definitions apply to the provisions of this chapter.

FIXED LADDER: A ladder that is permanently attached to a structure, building, or equipment.

GRAB BAR SYSTEM: A bar and associated anchorages and attachments to the structural system, for the support of body weight in locations such as toilets, showers, and tub enclosures.

GUARDRAIL SYSTEM: A system of components, including anchorages and attachments to the structural system, near open sides of an elevated surface for the purpose of minimizing the possibility of a fall from the elevated surface by people, equipment, or material.

HANDRAIL SYSTEM: A rail grasped by hand for guidance and support and associated anchorages and attachments to the structural system.

HELIPAD: A structural surface that is used for landing, taking off, taxiing, and parking of helicopters.

LIVE LOAD: A load produced by the use and occupancy of the building or other structure that does not include construction or environmental loads, such as wind load, snow load, rain load, earthquake load, flood load, or dead load.

ROOF LIVE LOAD: A load on a roof produced (1) during maintenance by workers, equipment, and materials, and (2) during the life of the structure by movable objects, such as planters or other similar small decorative appurtenances that are not occupancy related. An occupancy-related live load on a roof such as rooftop assembly areas, rooftop decks, and vegetative or landscaped roofs with occupiable areas, is considered to be a live load rather than a roof live load.

SCREEN ENCLOSURE: A building or part thereof, in whole or in part self-supporting, having walls and a roof of insect or sun screening using fiberglass, aluminum, plastic, or similar lightweight netting material, which encloses an occupancy or use such as outdoor swimming pools, patios or decks, and horticultural and agricultural production facilities.

VEHICLE BARRIER SYSTEM: A system of components, including anchorages and attachments to the structural system near open sides or walls of garage floors or ramps, that acts as a restraint for vehicles.

4.2 LOADS NOT SPECIFIED

For occupancies or uses not designated in this chapter, the live load shall be determined in accordance with a method approved by the Authority Having Jurisdiction.

4.3 UNIFORMLY DISTRIBUTED LIVE LOADS

4.3.1 Required Live Loads. The live loads used in the design of buildings and other structures shall be the maximum loads expected by the intended use or occupancy but shall in no case be

less than the minimum uniformly distributed unit loads required by Table 4.3-1.

4.3.2 Provision for Partitions. In office buildings and in other buildings where partition locations are subject to change, provisions for partition weight shall be made, whether or not partitions are shown on the plans. The partition load shall not be less than 15 psf (0.72 kN/m²).

EXCEPTION: A partition live load is not required where the minimum specified live load is 80 psf (3.83 kN/m²) or greater.

4.3.3 Partial Loading. The full intensity of the appropriately reduced live load applied only to a portion of a structure or member shall be accounted for if it produces a more unfavorable load effect than the same intensity applied over the full structure or member. Roof live loads shall be distributed as specified in Table 4.3-1.

4.4 CONCENTRATED LIVE LOADS

Floors, roofs, and other similar surfaces shall be designed to support the uniformly distributed live loads prescribed in Section 4.3 or the concentrated load, in pounds or kilonewtons (kN), given in Table 4.3-1, whichever produces the greater load effects. Unless otherwise specified, the indicated concentration shall be assumed to be uniformly distributed over an area 2.5 ft (762 mm) by 2.5 ft (762 mm) and shall be located so as to produce the maximum load effects in the members.

4.5 LOADS ON HANDRAIL, GUARDRAIL, GRAB BAR, AND VEHICLE BARRIER SYSTEMS, AND ON FIXED LADDERS

4.5.1 Handrail and Guardrail Systems. Handrail and guardrail systems shall be designed to resist a single concentrated load of 200 lb (0.89 kN) applied in any direction at any point on the handrail or top rail to produce the maximum load effect on the element being considered and to transfer this load through the supports to the structure.

4.5.1.1 Uniform Load. Handrail and guardrail systems shall also be designed to resist a load of 50 lb/ft (pound-force per linear foot) (0.73 kN/m) applied in any direction along the handrail or top rail and to transfer this load through the supports to the structure. This load need not be assumed to act concurrently with the concentrated load specified in Section 4.5.1.

EXCEPTIONS: The uniform load need not be considered for the following occupancies:


1. one- and two-family dwellings, and
2. factory, industrial, and storage occupancies in areas that are not accessible to the public and that serve an occupant load not greater than 50.

Live Load

Live Load (on projected area)

Floor live load

- by occupancy ✓
- 40 PSF to ~250 PSF

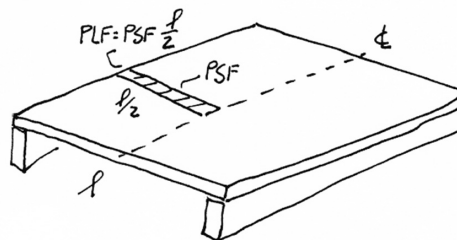

Roof live load

- construction or maintenance
- 12 PSF to 20 PSF (depending on area and slope)
- LRFD safety factor $\gamma = 1.6$ (depending on load combination)

Live Load

Floor Loads

OCCUPANCY OR USE	WEIGHT	CATEGORY
Fixed seats (fastened to flr)	60 PSF	Assembly areas & theaters
Lobbies	100 PSF	Assembly areas & theaters
Movable seats	100 PSF	Assembly areas & theaters
Stage floors	150 PSF	Assembly areas & theaters
Balconies (exterior)	100 PSF	
Bowling and poolrooms	75 PSF	Recreational areas
Dance halls & ballrooms	100 PSF	
Dining room & restaurants	100 PSF	
Gyms, main flrs & balconies	100 PSF	
Private rooms and corridors	40 PSF	Hotels and multifamily houses
Public rooms and corridors	100 PSF	Hotels and multifamily houses
Classrooms	40 PSF	Schools
Corridors above first floor	80 PSF	Schools
First floor corridor	100 PSF	Schools
Bleachers	100 PSF	Stadiums/arenas
Fixed seats (fastened to flr)	60 PSF	Stadiums/arenas
Light manufacturing	125 PSF	Manufacturing
Heavy manufacturing	250 PSF	Manufacturing
Habitable sleeping areas	30 PSF	Residential
All other areas (except stairs)	40 PSF	Residential

Roof Live Load

- Minimum L_r between 12 PSF and 20 PSF

$$L_r = \frac{20 R_1 R_2}{A_t}$$

Handwritten note: OK < 12

Area Reduction:

$$R_1 = \frac{1}{0.6} \quad \text{for } A_t \leq 200 \text{ ft}^2 (18.58 \text{ m}^2)$$

$$R_1 = \frac{1.2 - 0.001 A_t}{0.6} \quad \text{for } 200 \text{ ft}^2 < A_t < 600 \text{ ft}^2$$

$$R_1 = 1 \quad \text{for } A_t \geq 600 \text{ ft}^2 (55.74 \text{ m}^2)$$

where A_t = tributary area in ft^2 (m^2) supported by any structural member

Slope Reduction:

$$R_2 = \frac{1}{0.6} \quad \text{for } F \leq 4 \text{ "/>$$

Snow Load

Snow Load (on projected length)

Ground Snow

- p_g by region (see map)
- Ann Arbor 25 psf

Flat Roof


- $p_f = 70\% p_g \times \text{condition factors}$
(exposure, thermal, importance)

Sloped Roof


- $p_s = p_f \times \text{slope factors}$
- Balanced (full roof)
- Un-balanced

Safety Factor

- $\gamma = 1.6$



balanced



un-balanced

Snow Load

Ground Snow

- p_g by region
- Ann Arbor 25 psf

Flat Roof

- $p_f = 70\% p_g \times \text{condition factors}$
(exposure, thermal, importance)

Sloped Roof

- $p_s = p_f \times \text{slope factors}$
- Balanced (full roof)
- Un-balanced


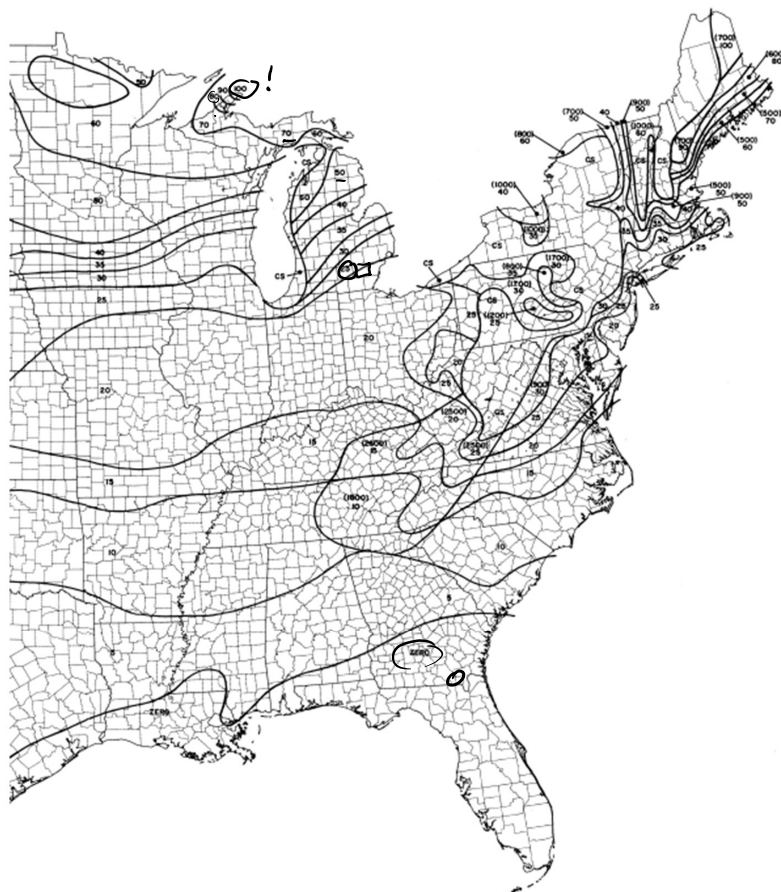


FIGURE 7-1 - continued
GROUND SNOW LOADS, p_g FOR THE UNITED STATES (lb/sq ft)

Snow Load

Drift Loading

- Windward
- Leeward
- Sawtooth

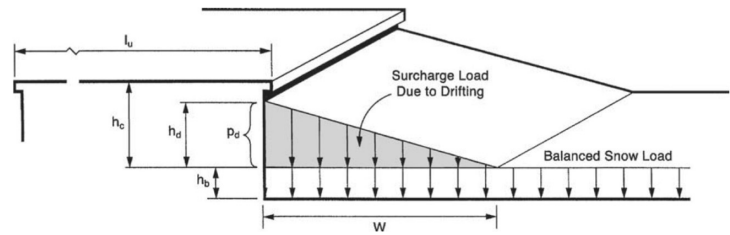


Ann Arbor

AA



Houghton, Michigan

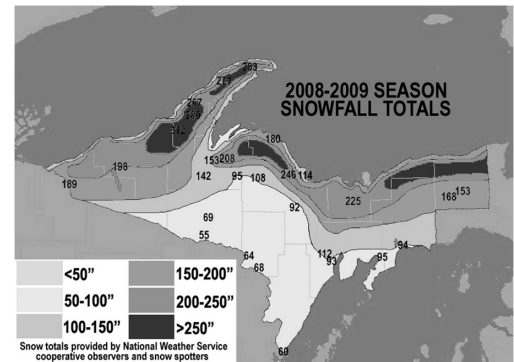

Snow Load

Pontiac Silverdome



Snow Load

Metrodome, Minneapolis

Dec. 11, 2010

